
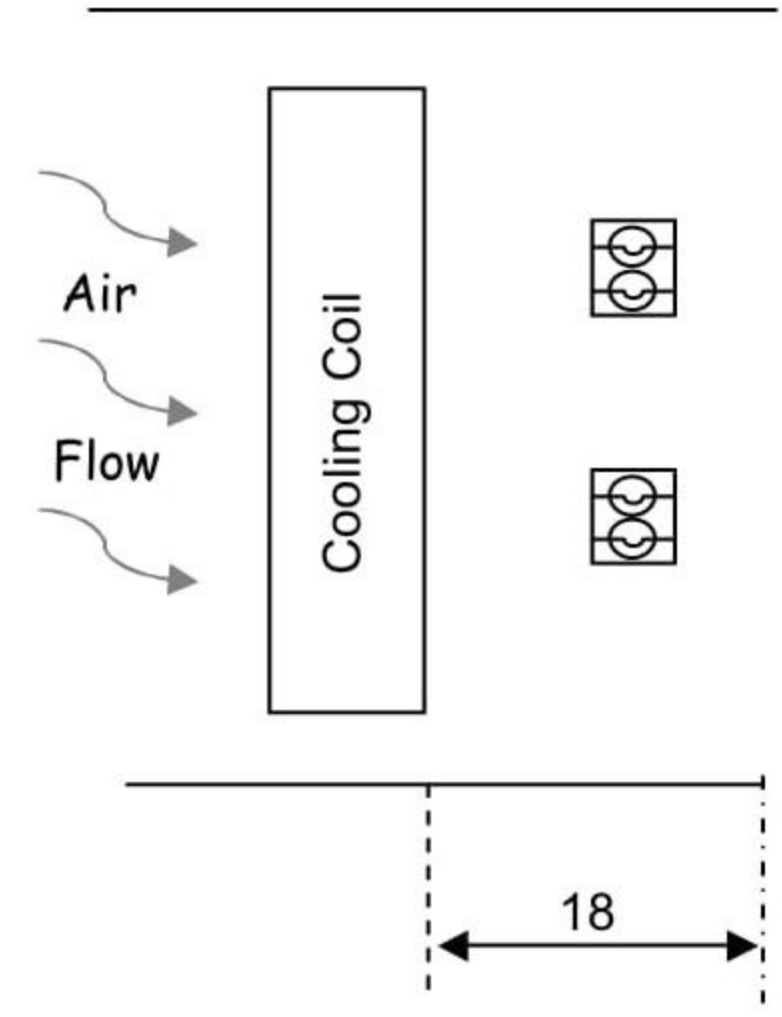


UV Cooling Coil Disinfection

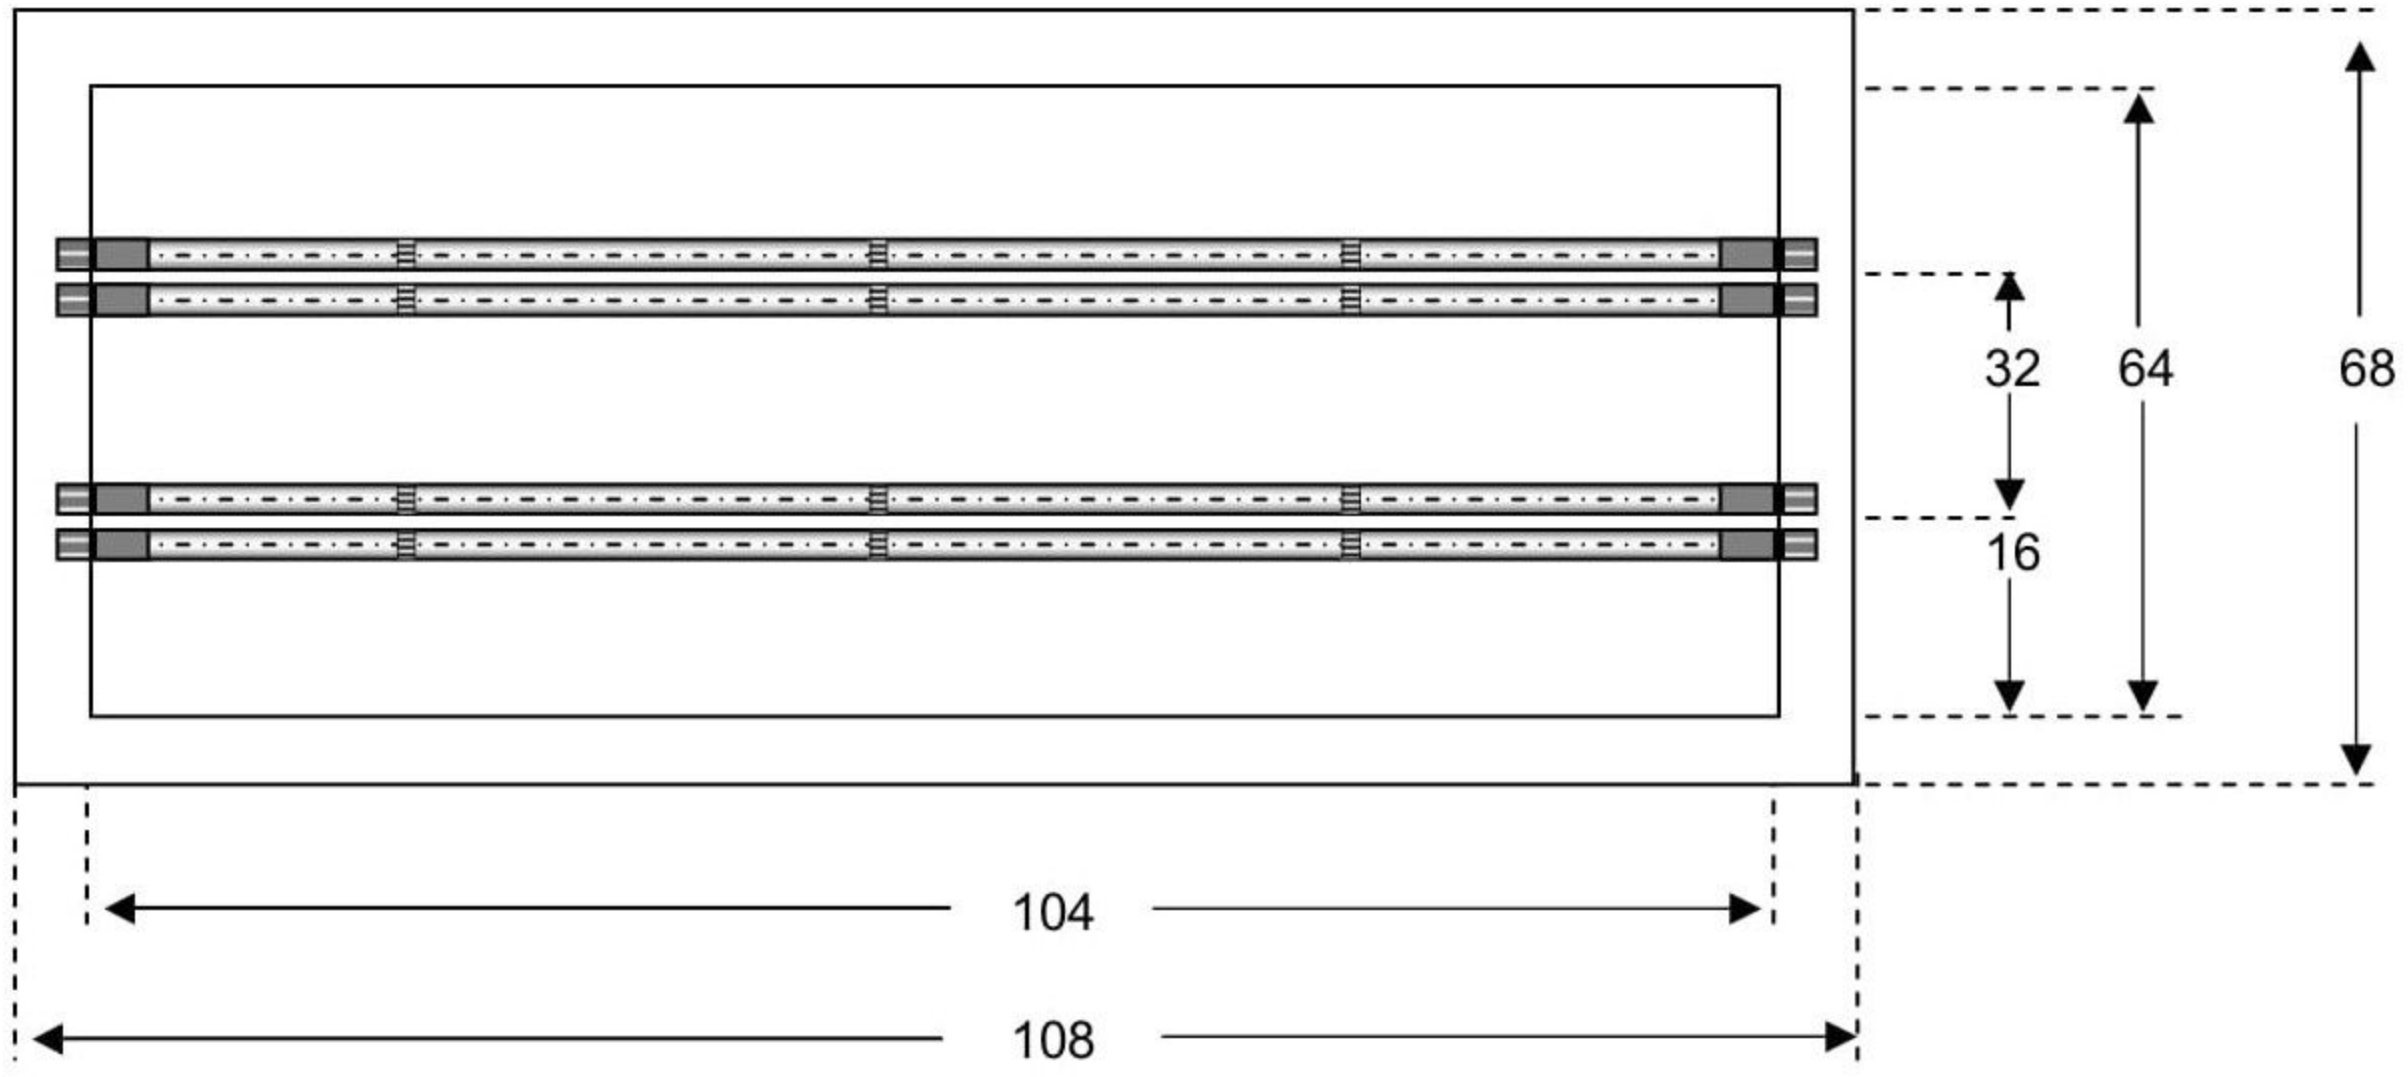

AMP DRAW PER EMITTER					
FIXTURE	120 Volts	230 Volts	277 Volts	Volts	
CC18-2	0.50	0.30	0.20	230	
CC24-2	1.15	0.70	0.60		
CC36-2	1.60	0.80	0.70		
CC48-2	2.30	1.20	1.00		
CC60.2	3.00	1.60	1.40		
0	Number of CC18-2 Fixtures per Row	0	Total CC18-2 Fixtures	2	Number of Rows High
0	Number of CC24-2 Fixtures per Row	0	Total CC24-2 Fixtures	108	Width of Housing
0	Number of CC36-2 Fixtures per Row	0	Total CC36-2 Fixtures	68	Height of Housing
2	Number of CC48-2 Fixtures per Row	4	Total CC48-2 Fixtures	104	Width of Coil
0	Number of CC60-2 Fixtures per Row	0	Total CC60-2 Fixtures	64	Height of Coil
				16	Height of First Row
				32	Center Spacing of Rows
				18	Coil to Emitter Center
				4.8	Total AMPS